

Brownell Transformer Breather

Refill Instructions



www.desicco.com.au


02 9844 5451

sales@desicco.com.au

1. Remove red cap from transformer breather



2. Remove o-ring and gauze filter

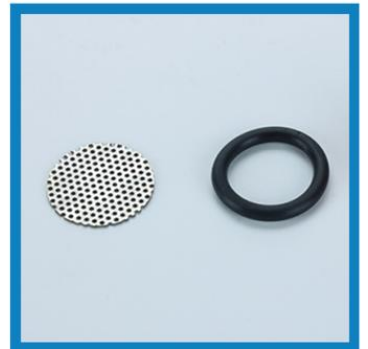

3. Fill breather with silica gel using a funnel



4. Place gauze filter in breather neck



5. Place o-ring over gauze filter



6. Screw on red cap until unit is ready to be installed on the transformer

